


Smoke Testing City of Southlake, Texas

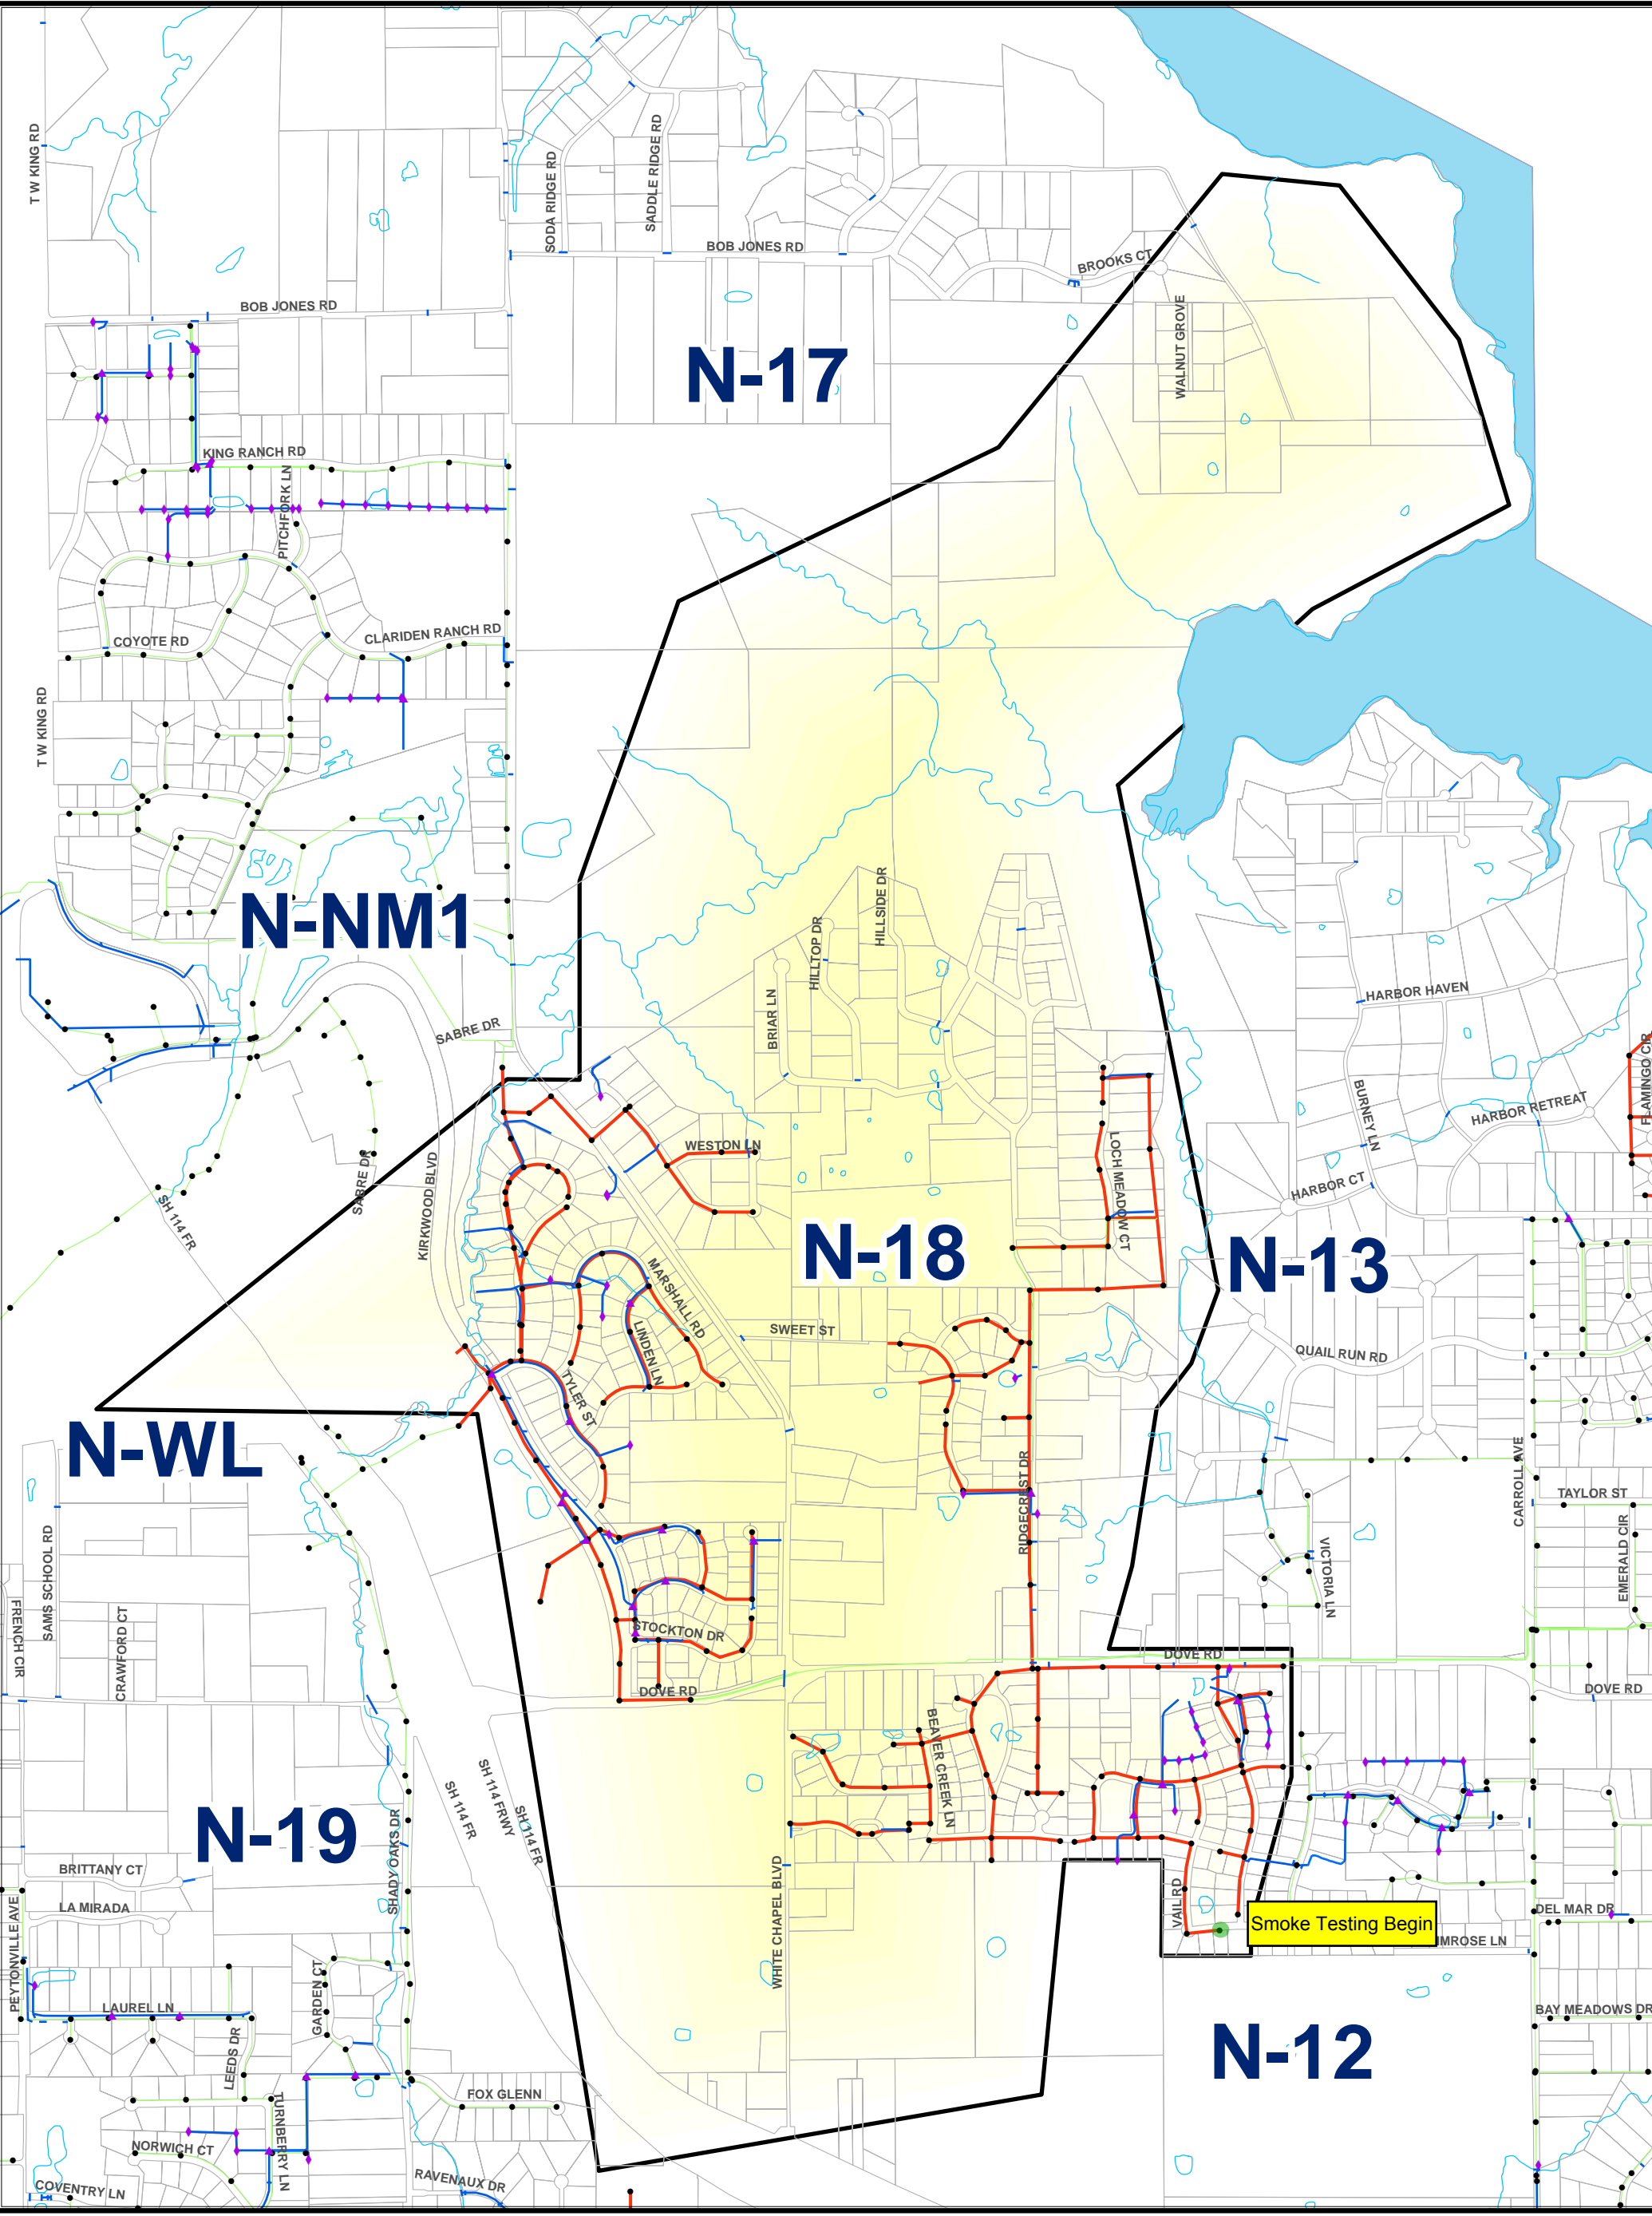

N-17

N-NM1

N-18

N-13

N-WL

N-19

N-12

Smoke Testing Begin

- | | |
|---|---|
| <ul style="list-style-type: none"> ▲ JunctionBox_MH ● CatchBasins ● SS_MH — Box — Channel — Pipe N-18 | <p>Sewer Lines</p> <p>Smoke Status</p> <ul style="list-style-type: none"> — Not In Study — Smoke Test Complete — Smoke Test Data Verified — Needs Smoke Test |
|---|---|